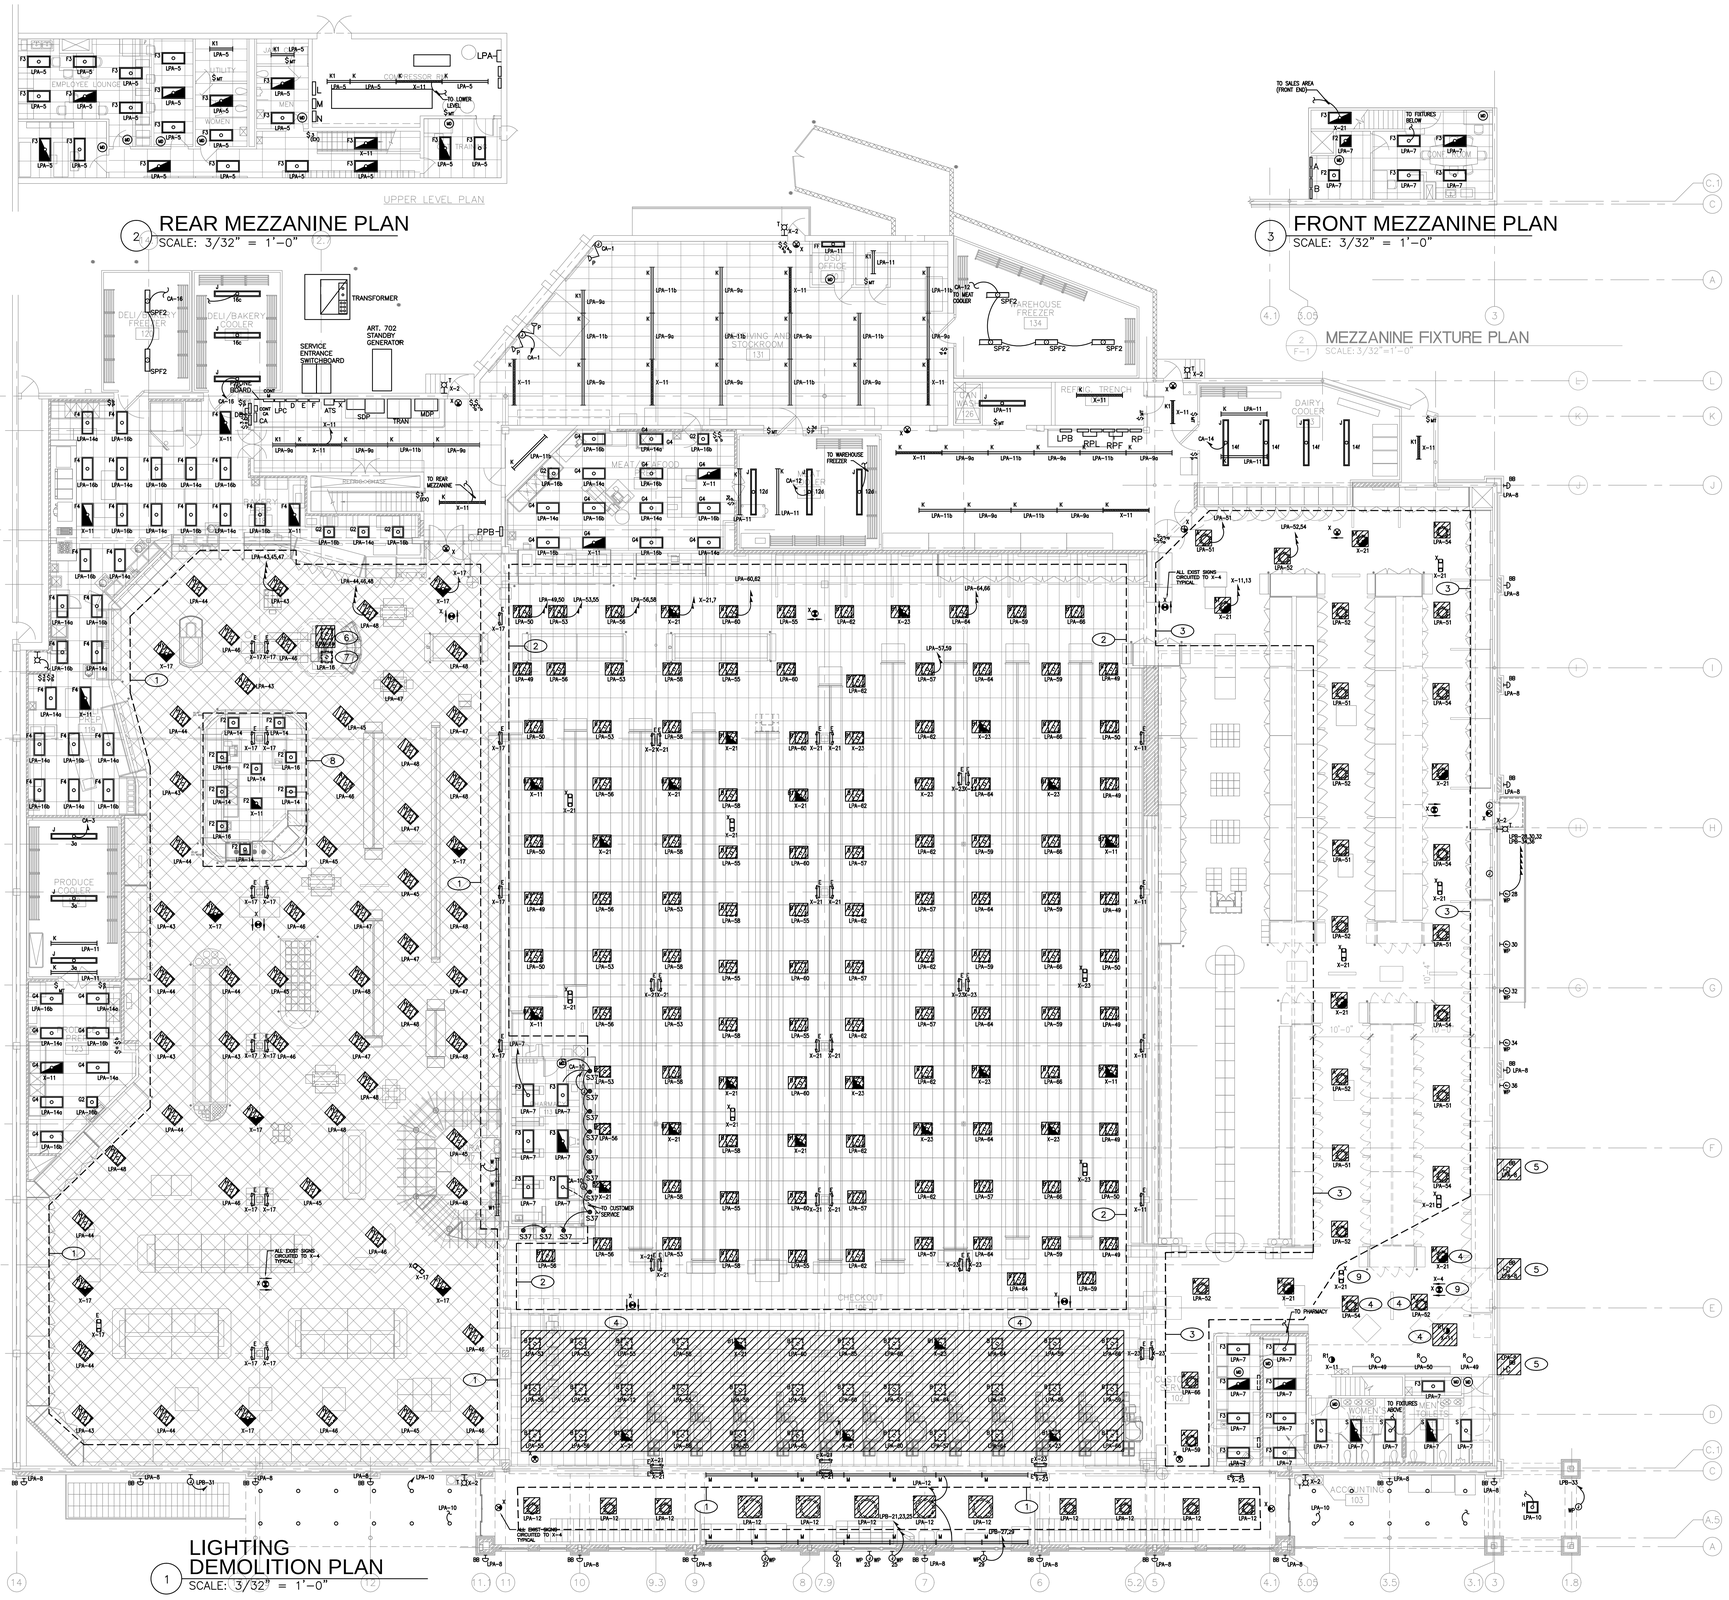

DEMOLITION NOTES

1. THE E.C. SHALL TAKE CARE TO MAINTAIN CONTINUITY OF CIRCUITS SERVING LIGHTING IN OTHER PORTIONS OF THE BUILDING THAT ARE EXISTING TO REMAIN. PROVIDE CONNECTIONS BETWEEN LIGHTING THAT IS EXISTING TO REMAIN WHETHER SHOWN ON THESE DRAWINGS OR NOT.
2. THE E.C. SHALL FIELD VERIFY EXACT LOCATIONS AND QUANTITY OF LIGHTING TO BE REPLACED PRIOR TO BID.
3. E.C. SHALL MAINTAIN EXIT AND EMERGENCY EGRESS LIGHTING FOR THE BUILDING THROUGHOUT THE COARSE OF THE RENOVATION. PROVIDE TEMPORARY POWER AND LIGHTING AS REQUIRED.

KEY NOTES (XX)

1. DISCONNECT AND REMOVE HATCHED FIXTURES WITHIN DASHED AREA TO ALLOW FOR FIXTURE REPLACEMENT. PRESERVE WIRING AND RECONNECT TO NEW FIXTURES AS SHOWN ON E2.1 AT SAME LOCATION. NO CHANGE IN CIRCUITRY OR CONTROL REQUIRED.
2. DISCONNECT AND REMOVE HATCHED FIXTURE WITHIN DASHED AREA TO ALLOW FOR FIXTURE REPLACEMENT. PRESERVE WIRING AND RECONNECT TO NEW FIXTURES AS SHOWN ON E2.1. NOTE, NEW 2X4 FIXTURES MAY NEED TO BE SHIFTED WITHIN THE CEILING GRID TO AVOID EXISTING SPRINKLER HEADS OR DIFFUSER LOCATIONS. FIELD COORDINATE THESE SHIFTS WITH THE HT PROJECT MANAGER. EXTEND WIRING AS REQUIRED. NO CHANGE IN CIRCUITRY OR CONTROL REQUIRED.
3. DISCONNECT AND REMOVE HATCHED HIGHBAY FIXTURES WITHIN DASHED AREA TO ALLOW FOR FIXTURE REPLACEMENT. PRESERVE FIXTURE STEMS AND WIRING FOR RECONNECTION TO NEW HIGHBAY FIXTURES AS SHOWN ON E2.1. NO CHANGE TO CIRCUITRY OR CONTROL REQUIRED.
4. DEMOLISH FIXTURES WITHIN HATCHED AREA. REMOVE WIRING AND PROVIDE JUNCTIONS AS REQUIRED TO MAINTAIN CONTINUITY TO PORTIONS OF THE CIRCUIT THAT ARE EXISTING TO REMAIN.
5. DISCONNECT AND REMOVE FIXTURE TO ALLOW FOR DEMOLITION OF WALL. PRESERVE FIXTURE FOR RE-INSTALLATION ONTO NEW WALL. SEE E2.1. TYPICAL OF ALL TYPE BB FIXTURES.
6. DISCONNECT AND REMOVE EXISTING FIXTURE. CAP CIRCUIT IN JUNCTION BOX ABOVE.
7. RELOCATE FIXTURE TO LOCATION SHOWN ON E2.1.
8. REMOVE AND REINSTALL EXISTING FIXTURES WITHIN DASHED AREA AS REQUIRED. TO ALLOW FOR THE INSTALLATION OF THE NEW DECOR BULKHEAD.
9. RELOCATE EXISTING EXIT OR EMERGENCY LIGHT TO CEILING OR DECOR GRID BELOW. SEE E2.1 FOR NEW LOCATION.

ARCONS DESIGN STUDIO
architecture planning interiors
10550 Independence Pointe Parkway
Suite 300
Matthews, North Carolina 28105
P: 704.542.5252 F: 704.542.2330
www.arconsds.com

BRANDT ENGINEERING, INC.
NC LICENSE NO: C-1504
2840 POLO PARKWAY, SUITE 200
MIDLOTHIAN, VA 23113
PHONE: (804)794-6656
FAX: (804)794-8588
EMAIL: cedd@beinc.com

Harris Teeter
Your Neighborhood Food and Pharmacy

NOTE: THIS DOCUMENT MAY HAVE BEEN ELECTRONICALLY TRANSMITTED. IF UNSIGNED, IT CANNOT BE FILED FOR PUBLIC RECORD. PUBLIC RECORD FILINGS REQUIRE SIGNED AND SEALED DOCUMENTS.

NORTH CAROLINA PROFESSIONAL ENGINEER 028543 KNOX STACY

Electronically Signed By:
Robert K Stacy
Using IdenTrust Certificate
2016.08.24 14:59:50-04'00'

HARRIS TEETER
STORE # 208
COTSWOLD SHOPPING CENTER
CHARLOTTE, NC

PROJECT MANAGER
KNOX STACY

JOB NO.
15-HT208-02

DR. BY.

REVISIONS

No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____
No. ____	Date ____

DRAWING NAME

LIGHTING DEMOLITION PLAN

ISSUE DATE: 08.23.16

SHEET NO.
E2.0

8/24/2016 2:07:17 PM