


REVISIONS	No.	Date

- GENERAL DEMOLITION NOTES:**
- REFER TO ELECTRICAL RENOVATION PLANS AND ARCHITECTURAL FIXTURE PLANS FOR NEW EQUIPMENT LAYOUT AND THE EXTENT OF FIXTURES/EQUIPMENT BEING REPLACED, RELOCATED OR REMOVED.
 - EXISTING CONDITIONS SHOWN ARE BASED ON EXISTING DRAWINGS AND MAY NOT BE COMPLETE OR ALL. INCLUSIVE OF THE CIRCUITS OR DEVICES TO BE DEMOLISHED OR RELOCATED. THE ELECTRICAL CONTRACTOR SHALL SURVEY THE EXISTING CONDITIONS TO DETERMINE THE EXTENT OF THE RENOVATION AND DETERMINE WHAT CONDUIT, WIRING, DEVICES, ETC. MAY BE REUSED IN PLACE FOR THE RENOVATION WORK TO BE PERFORMED.
 - EXISTING CONDUIT AND WIRING THAT IS REUSED MUST BE IN GOOD CONDITION AND MEET THE REQUIREMENTS OF THE CIRCUIT OR EQUIPMENT AS INDICATED ON THE RENOVATION PLANS AND PANEL SCHEDULES.
 - WHERE ELECTRICAL DEVICES ARE REMOVED PROVIDE JUNCTION BOXES, CONDUIT AND WIRING AS REQUIRED TO MAINTAIN THE CONTINUITY OF THE CIRCUIT SERVING EQUIPMENT OR DEVICES THAT ARE EXISTING TO REMAIN.
 - WHERE WALL FINISHES ARE BEING REMOVED, REPAIRED OR REPLACED, REMOVE AND REINSTALL ELECTRICAL DEVICES, PLATES AND EQUIPMENT AS REQUIRED. COORDINATE SUCH LOCATION WITH THE ARCHITECTURAL PLANS.
 - DISPOSE OF DEMOLISHED MATERIALS AS DIRECTED BY THE HTPM. RETURN ANY UNUSED EQUIPMENT TO THE HTPM.

- KEY NOTES:**
- DISCONNECT CIRCUITS SERVING U-SCANS AND VENDOR DRINKS TO ALLOW FOR RELOCATION OF EQUIPMENT. RELOCATE / EXTEND WIRING AS REQUIRED TO NEW EQUIPMENT LOCATIONS AND RECONNECT TO OPERATE AS BEFORE. SEE E3.1 FOR ADDITIONAL INFORMATION.
 - DISCONNECT CIRCUITS AND ELECTRICAL DEVICES FROM BACK OF CASE TO ALLOW FOR CASE REPLACEMENT. PRESERVE WIRING AND DEVICES. REINSTALL AND RECONNECT TO BACK OF NEW CASE AS SHOWN ON E3.1.
 - DISCONNECT CASE TO ALLOW FOR CASE REPLACEMENT. PRESERVE WIRING AND RECONNECT TO NEW CASE AS SHOWN ON E3.1.
 - DISCONNECT CIRCUITS FROM CASES TO BE REMOVED. PRESERVE WIRING AND RECONNECT TO NEW CASES AS SHOWN ON E3.1. RELOCATE OR EXTEND CIRCUITS AS REQUIRED. REMOVE ANY UNUSED CIRCUITS BACK TO THE SOURCE. RE-LABEL PANEL SCHEDULE WITH CORRECT DESCRIPTION.
 - DISCONNECT WIRING FROM CASE TO BE REMOVED. REMOVE WIRING BACK TO SOURCE AND MARK BREAKER AS SPARE.

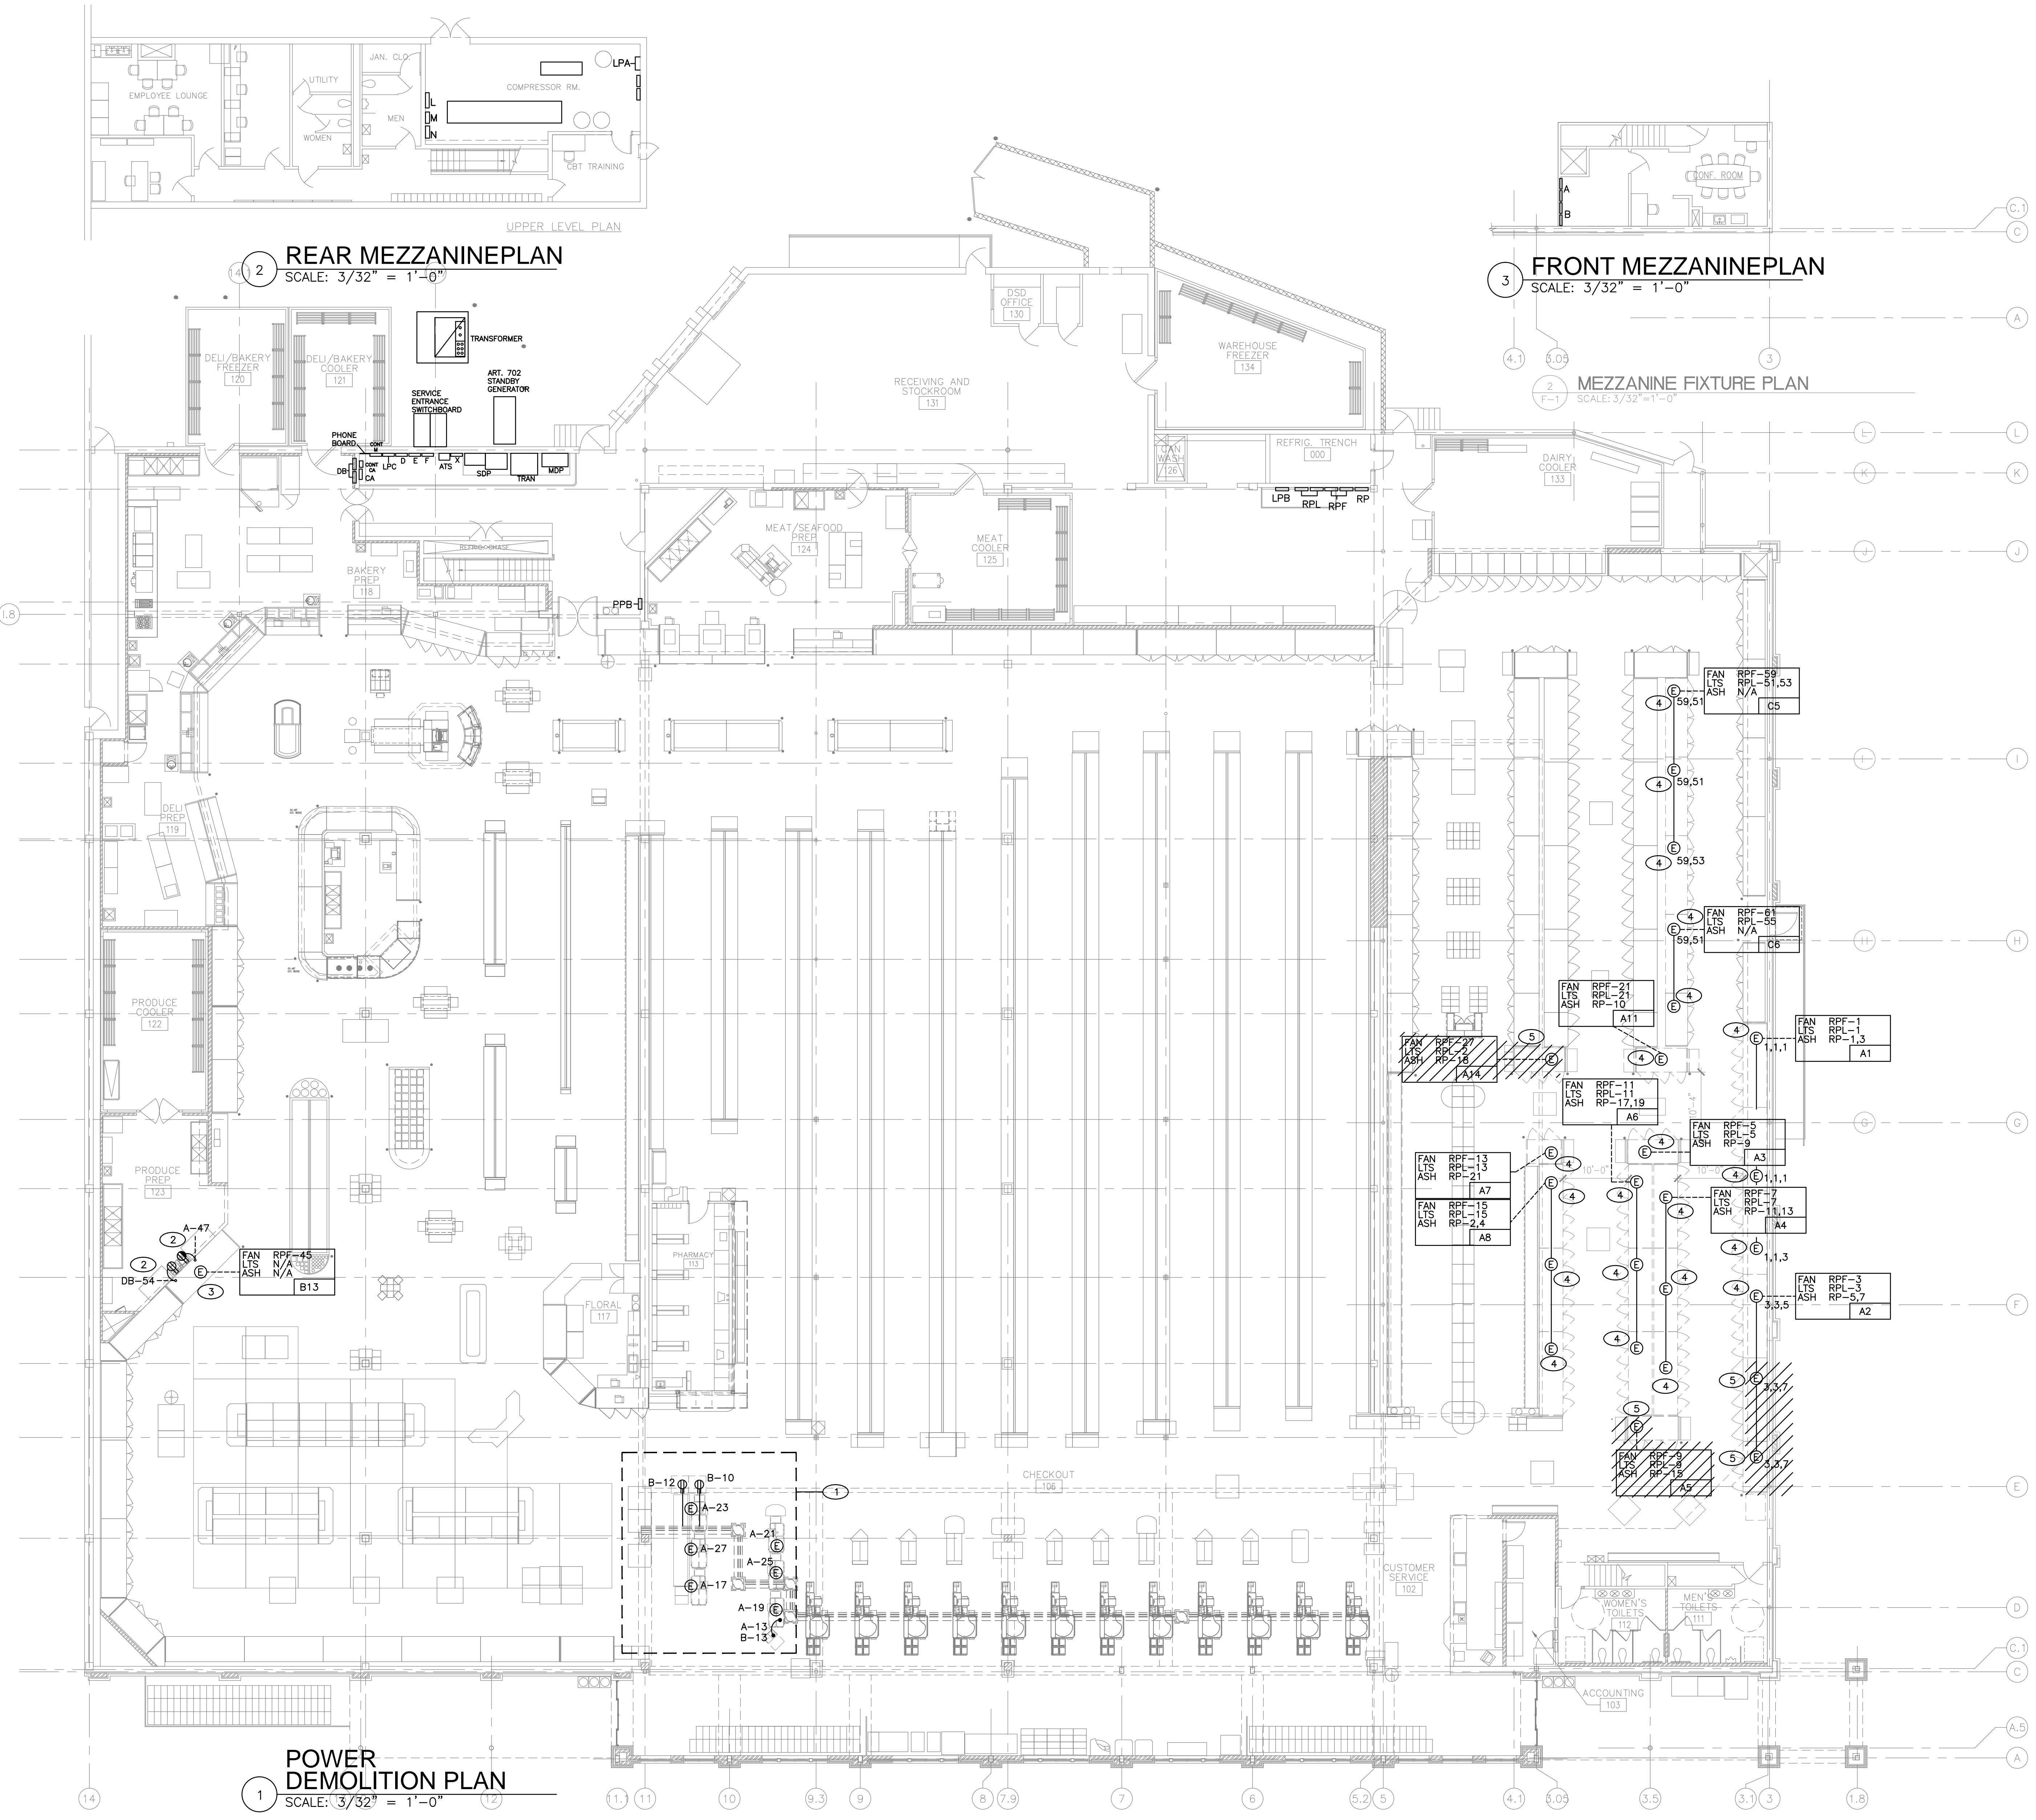

8/24/2016 2:07:36 PM