


DEMOLITION GENERAL NOTES

1. THE DEMOLITION PLANS WERE DERIVED FROM EXISTING BUILDING PLANS AND SITE VISITS AND ARE INTENDED TO REASONABLY REPRESENT EXISTING CONDITIONS. HOWEVER, ACTUAL CONDITIONS MAY DEVIATE FROM THAT SHOWN ON THE DRAWINGS. THE DEMOLITION KEY NOTES IDENTIFY SPECIFIC AREAS OF WORK BUT MAY NOT BE COMPLETE IN IDENTIFICATION OF ALL REMOVALS REQUIRED FOR INSTALLATION OF NEW WORK. THE CONTRACTOR SHALL VERIFY ACTUAL CONDITIONS AND COORDINATE THE DEMOLITION WITH NEW WORK SO THAT DEMOLITION IS COMPLETE AS REQUIRED TO NOT OBSTRUCT PROPER EXECUTION OF THE CONTRACT WORK.
2. COORDINATE DEMOLITION/REMOVAL OF EXISTING HVAC EQUIPMENT/SYSTEMS WITH GENERAL CONTRACTOR AND HARRIS TEETER PROJECT MANAGER TO MAINTAIN SYSTEMS OPERATIONAL AS REQUIRED TO ALLOW UNINTERRUPTED STORE OPERATIONS DURING THE COURSE OF THE RENOVATION.

DEMOLITION KEYED NOTES

- 01 REMOVE EXISTING SPLIT SYSTEM INDOOR AIR HANDLING UNIT, ROOF MOUNTED CONDENSING UNIT, ROOF MOUNTED OUTSIDE AIR INTAKE LOUVERED PENTHOUSE, INTERCONNECTING REFRIGERANT PIPING, SUPPLY, RETURN AND OUTSIDE AIR DUCTWORK AND ASSOCIATED HANGERS, SUPPORTS AND MISCELLANEOUS APPURTENANCES AS INDICATED OR AS REQUIRED FOR CONNECTION OF EXISTING DUCTWORK TO NEW ROOFTOP UNIT. CAP EXISTING PIPING PENETRATION AND OUTSIDE AIR INTAKE CURBS WITH INSULATED SHEET METAL CURB CAP. SEE ARCHITECTURAL DRAWINGS FOR CURB CAP DETAIL. SEE RENOVATION PLANS FOR PLACEMENT OF NEW ROOFTOP UNIT, SUPPORT DUNNAGE AND DUCT ROOF PENETRATION CURBS.
- 02 REMOVE EXISTING DUCT MOUNTED ELECTRIC DUCT HEATER AND ASSOCIATED HANGERS, SUPPORTS AND MISCELLANEOUS APPURTENANCES AS INDICATED OR AS REQUIRED FOR CONNECTION OF EXISTING DUCTWORK TO NEW ROOFTOP UNIT.
- 03 REMOVE EXISTING ROOF MOUNTED EXHAUST FAN, EXISTING ROOF CURB AND DUCTWORK TO REMAIN FOR INSTALLATION OF REPLACEMENT FAN. FIELD VERIFY EXISTING CURB SIZE AND PROVIDE CURB ADAPTER AS REQUIRED TO ALLOW NEW FAN TO BE MOUNTED ON EXISTING CURB AND CONNECT TO EXISTING DUCT.
- 04 REMOVE EXISTING DUCT/WALL MOUNTED SUPPLY/RETURN AIR GRILLES AS INDICATED AND PROVIDE NEW GRILLE TO MATCH EXISTING. FIELD VERIFY EXISTING GRILLE SIZES AND TYPES PRIOR TO REMOVAL OF EXISTING GRILLES AND ORDERING OF REPLACEMENT GRILLES.
- 05 REMOVE EXISTING RETURN AIR GRILLE AND PROVIDE NEW CEILING TILE OR PATCH WALL TO MATCH EXISTING TO REPLACE EXISTING GRILLES.
- 06 REMOVE EXISTING WALL MOUNTED TEMPERATURE/HUMIDITY SENSOR. SEE RENOVATION FLOOR PLANS FOR NEW TEMPERATURE AND DEWPOINT SENSOR LOCATIONS.
- 07 DISCONNECT BRANCH DUCT CONNECTION AS REQUIRED AND ROTATE 180° TO ACCOMMODATE CHANGE IN AIR FLOW DIRECTION. RECONNECT TO EXISTING DUCT.
- 08 REMOVE EXISTING DUCT AS INDICATED TO ALLOW FOR NEW DUCT CONNECTION. SEE RENOVATION PLAN FOR NEW DUCT CONNECTION.
- 09 REMOVE EXISTING O.A. INTAKE GOOSENECK, CURB TO REMAIN. CAP EXISTING CURB WITH INSULATED SHEET METAL CURB CAP. SEE ARCHITECTURAL DRAWINGS FOR CURB CAP DETAIL.

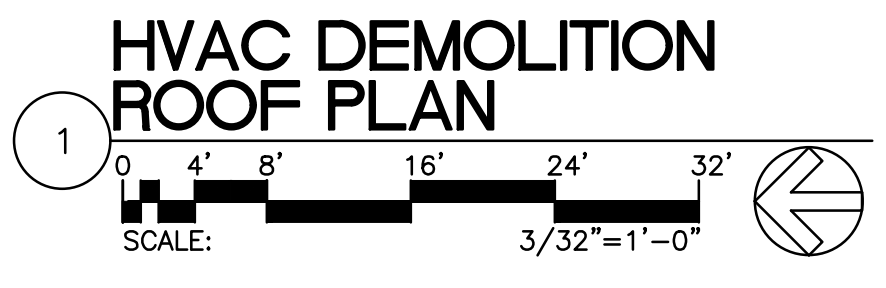

NOTE: THIS DOCUMENT MAY HAVE BEEN ELECTRONICALLY TRANSMITTED. IF UNSIGNED, IT CANNOT BE FILED FOR PUBLIC RECORD. PUBLIC RECORD FILINGS REQUIRE SIGNED AND SEALED DOCUMENTS.