


**GENERAL NOTES**

- COORDINATE THE SIZES AND LOCATIONS OF HVAC EQUIPMENT, CURBS AND ROOF OPENINGS WITH STRUCTURAL STEEL.
- INSTALL ROOFTOP UNITS LEVEL FOR PROPER CONDENSATE DRAINAGE. REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR ROOF SLOPE.
- TRAP AND ROUTE CONDENSATE DRAIN LINES FROM ROOFTOP UNITS A MINIMUM OF 2 FT. AWAY FROM THE UNITS TOWARD ROOF DRAINS OR TO LOW SIDE OF SLOPED ROOF.
- ALL EXHAUST FANS SHALL TERMINATE AT THE ELEVATIONS REQUIRED BY THE APPLICABLE IMC AND NFPA CODES.
- ALL RTU OUTDOOR AIR INTAKES SHALL BE LOCATED A MINIMUM OF 10'-0" AWAY FROM ALL FLUES, PLUMBING VENTS, EXHAUST AIR OR SOURCES OF CONTAMINANTS.
- PROVIDE BURGLAR BARS FOR ALL NON-GREASE DUCT ROOF PENETRATIONS OF 12"x12" OR LARGER.

**KEYED NOTES**

- PROVIDE NEW RTU ON NEW STEEL SUPPORT DUNNAGE AND NEW INSULATED ROOF CURBS AT NEW SUPPLY AND RETURN AIR DUCT ROOF PENETRATIONS. COORDINATE EXACT CURB/DUCT PENETRATION LOCATIONS WITH THE EXISTING ROOF STRUCTURE AND NEW STEEL SUPPORT DUNNAGE. CONNECT NEW SUPPLY AIR DUCT TO EXISTING DUCT ABOVE CEILING.
- PROVIDE NEW FAN ON EXISTING CURB. FIELD VERIFY EXISTING CURB DIMENSIONS AND PROVIDE CURB ADAPTER SIZED AS REQUIRED TO ALLOW NEW FAN TO FIT ON EXISTING CURB.
- REPLACE EXISTING SALES AREA RETURN AIR GRILLES. FIELD VERIFY EXISTING GRILLE SIZES AND TYPES PRIOR TO REMOVAL OF EXISTING GRILLES AND PRIOR TO ORDERING NEW GRILLES.
- PROVIDE NEW SUPPLY/RETURN AIR DUCT AS INDICATED OR REQUIRED TO ACCOMMODATE THE INSTALLTION OF THE NEW RTU AND CONNECTION OF NEW SUPPLY DUCT TO EXISTING.
- PROVIDE NEW RTU ON NEW CURB. COORDINATE EXACT RTU CURB/DUCT PENETRATION LOCATIONS WITH THE EXISTING ROOF STRUCTURE.
- CAP EXISTING ABANDONED ROOF CURB WITH INSULATED GALVANIZED SHEET METAL CURB CAP. SEE ARCHITECTURAL PLANS FOR CURB CAP DETAILS.
- PROVIDE 4" DIAMETER WELDED STAINLESS STEEL EXHAUST DUCT FROM NEW PIZZA OVEN VENT CONNECTION AND OFFSET DISCHARGE UNDER CENTER OF EXISTING EXHAUST HOOD.
- REVISE EXISTING HOOD FIRE SUPPRESSION SYSTEM NOZZLE LOCATIONS AS REQUIRED TO ACCOMMODATE NEW AND EXISTING COOKING EQUIPMENT LINEUP UNDER THE EXISTING HOOD AND MEET CURRENT CODE.
- DISCONNECT BRANCH DUCT CONNECTION AS REQUIRED AND ROTATE 180° TO ACCOMMODATE CHANGE IN AIR FLOW DIRECTION. RECONNECT TO EXISTING DUCT.

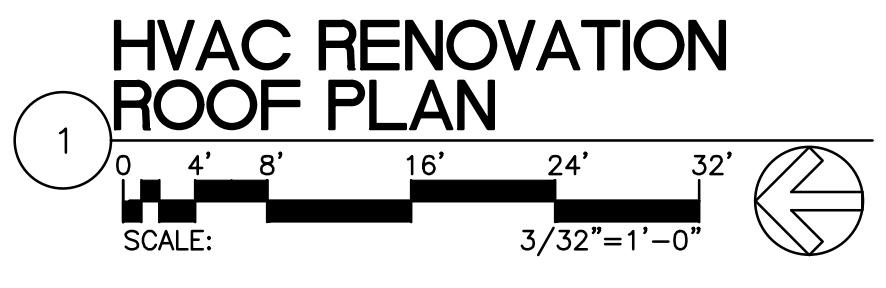

NOTE: THIS DOCUMENT MAY HAVE BEEN ELECTRONICALLY TRANSMITTED. IF UNSIGNED, IT CANNOT BE FILED FOR PUBLIC RECORD. PUBLIC RECORD FILINGS REQUIRE SIGNED AND SEALED DOCUMENTS.